


HALF PVC PIPE



STACKED/BRIDGED STYROFOAM INSULATION

NOTES: DETAIL DESIGNED TO ACCOMMODATE MAXIMUM 50% TOTAL MOVEMENT.  
 BACKER ROD SHOULD BE A MINIMUM 1" LARGER IN DIAMETER THAN MAXIMUM AS-BUILT JOINT OPENING.  
 IN COVERED/BURIED CONDITIONS, ADEQUATE PROTECTION MUST BE PROVIDED FOR FLASHING FROM SUBSEQUENT TOPPING/BACKFILL. WHENEVER POSSIBLE THE EXPANSION JOINT SHOULD BE EXTENDED UP THROUGH ALL TOPPING LAYERS.

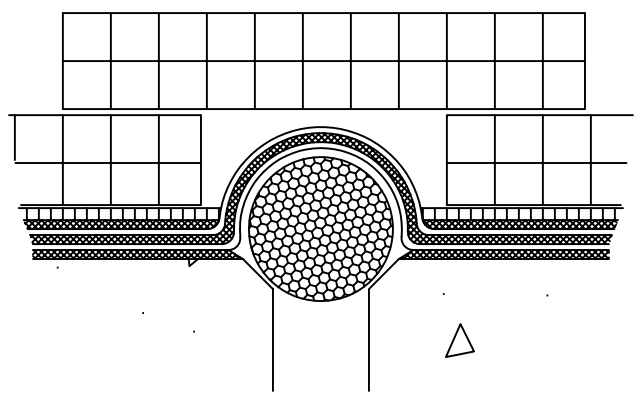

**HYDROTECH**  
 Monolithic Membrane  
 6125-FR  
 WATERPROOFING SYSTEMS

**AMERICAN HYDROTECH, INC.**

FIELD EXPANSION JOINTS 1" - 2" MAX. AS-BUILT WIDTHS	
3" = 1'-0"	W-6B